

Pole, Creosote treated or equivalent, 20' Length  
6"-8" Round top (minimum)

Weatherhead

SE (Service Entrance) cable or single wires;  
• Extend a minimum of 18" from weatherhead  
• Neutral wire shall be marked for identification

Conduit straps at 2' intervals

Conduit, Rigid, PVC Schedule 80 or equivalent. Raintight fitting

150 Amp Meter Base;

- 1/0 Copper (minimum)-RH,RW,RHW or equivalent
- 1-1/2" Threaded Hub

200 Amp Meter Base;

- 2/0 Copper (minimum)-RH,RW,RHW or equivalent
- 2" Threaded Hub


Nipple, length as required, lockwashers & pull bushings to maintain weatherproof standard.

Service Main Disconnect, Fused or Circuit Breaker type;

- "Weatherproof"(NEC)
- 100 amp minimum standard
- 60 amp minimum for temporary or construction power only

Ground wire, #4 soft drawn copper (minimum), stapled

Ground Copper Clad or Galvanized-5/8" x 8'-0"  
Must be driven just below finished grade  
Ground wire attached with approved one bolt ground clamp (Acorn)

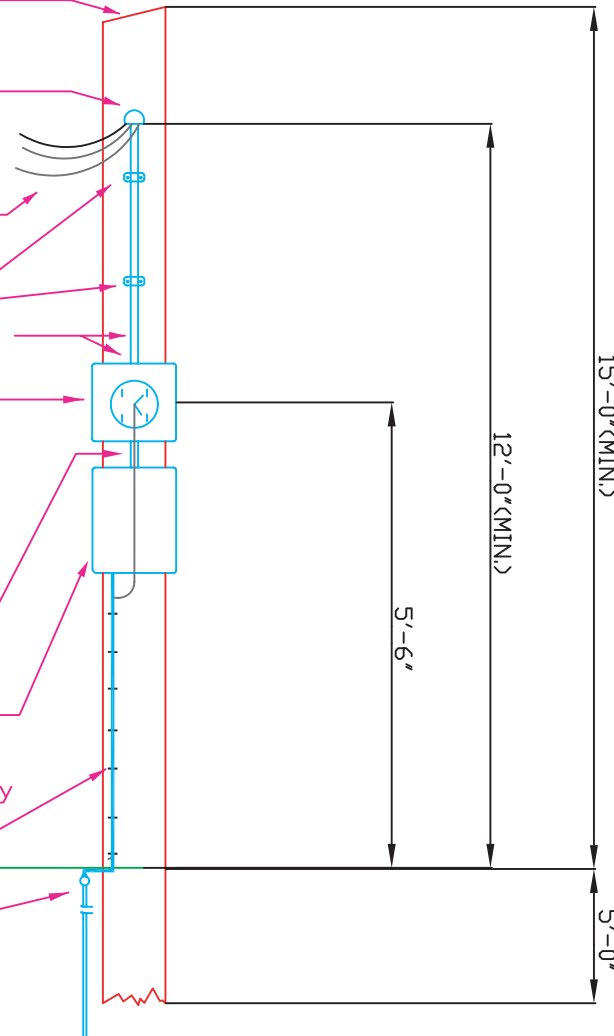

NOTES: Location of pole will need approval by BECI Service Dept. personnel before installation.

## METER POLE OVERHEAD SOURCE

BEAUREGARD ELECTRIC COOPERATIVE INC.  
DERIDDER, LOUISIANA 70634

\*NOTIFY CITY, MUNICIPAL, OR PARISH FOR ANY CODES, PERMITS OR REQUIREMENTS APPLICABLE.

\*FACILITIES SHALL COMPLY WITH NATIONAL ELECTRIC CODE (NEC)

\*LA-1 CALL 1-800-272-3020  
PLEASE CALL BEFORE DIGGING